

REVISION	BY	DATE
1	AS	2/1/08



N. KY. WATER DISTRICT
ENCASEMENT PIPE DETAIL

DRAWN BY:
SAR

APPROVED:
AS

DATE:
1/2/08

STANDARD
DRAWING NO:
114

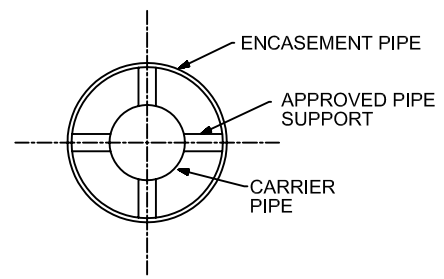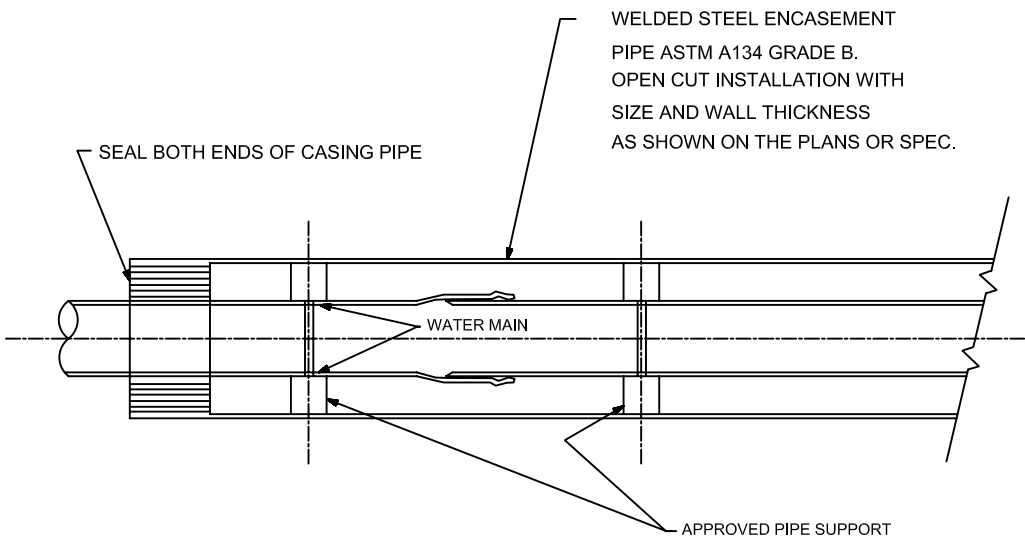

NOTE: CASING PIPE JOINTS SHALL BE SEAM WELDED SO THAT CASING IS WATER TIGHT FROM END TO END.

ENCASEMENT PIPE DETAIL

NO SCALE