

REVISION	BY	DATE
1	AS	2/1/10


N. KY. WATER DISTRICT
ENCASEMENT PIPE DETAIL

DRAWN BY:
SAR

APPROVED:
RA

DATE:
2/02/11

STANDARD
DRAWING NO:
114

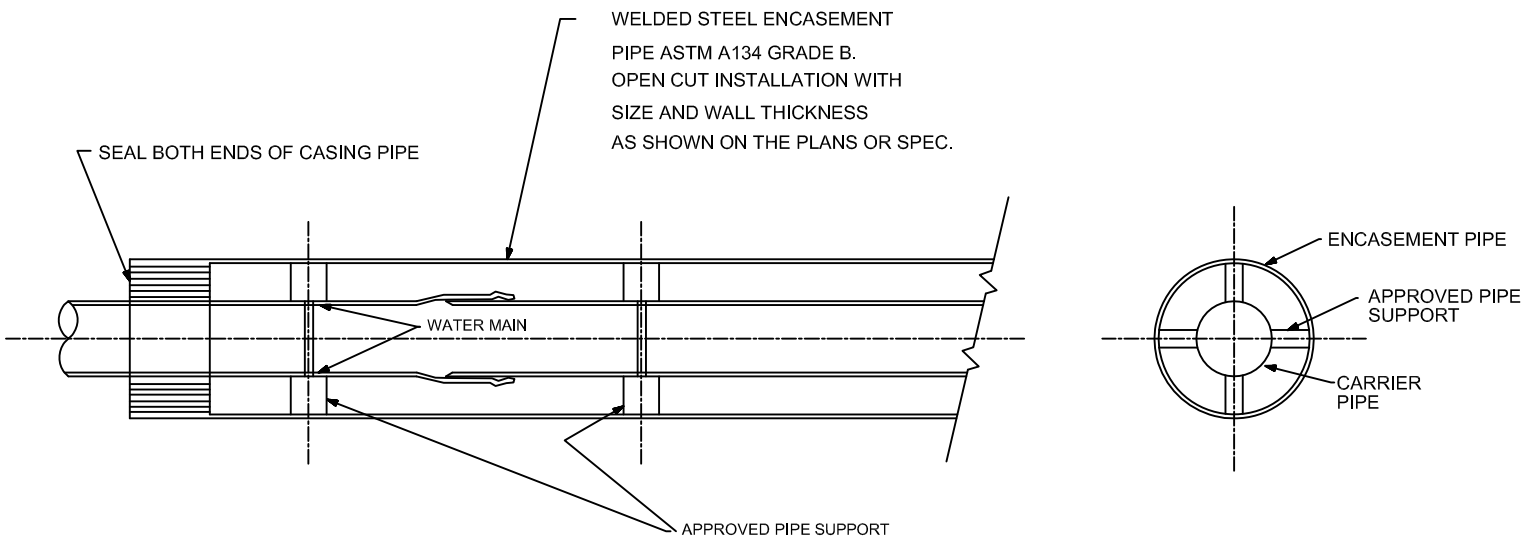

1. All carrier pipe placed in steel casing pipe shall be minimum class 50 ductile iron pipe and conform to the latest edition of AWWA C151.
2. Carrier pipe gaskets shall develop a wedging action between pairs of high-strength stainless steel elements spaced around the gasket (FIELD LOK , FASTGRIP, or approved equal gaskets).

NOTE: CASING PIPE JOINTS SHALL BE SEAM WELDED SO THAT CASING IS WATER TIGHT FROM END TO END.

ENCASEMENT PIPE DETAIL

NO SCALE