


PLAN

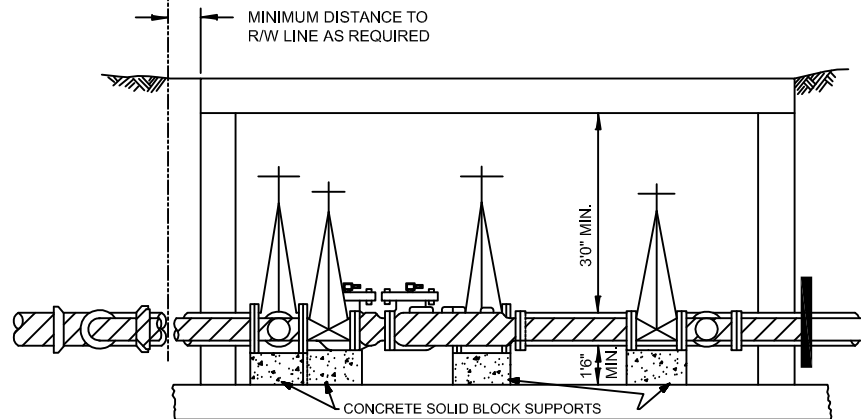

ELEVATION

DRAWING NOTES

- ① REFER TO DRAWING NO. 204 FOR DETAILS OF FIRE BRANCH PIPING.
- ② 2.5" OR LARGER DOMESTIC COMPOUND METER REFER TO DRAWING NO.205 FOR DETAILS OF DOMESTIC SERVICE LINE PIPING.
- ③ FLANGED COUPLING ADAPTER OVER PLAIN END PIPE 1'0" LONG MINIMUM. (OPTIONAL)
- ④ PROVIDE CONCRETE THRUST BLOCKS (SEE DRAWING NO. 104) OR OTHER APPROVED MEANS AS REQUIRED TO RESTAIN JOINTS.
- ⑤ STRAINER
- ⑥ SHADED AREA DISTRICTS RESPONSIBILITY

GENERAL NOTES

- 1. SEE DRAWING NO. 202 FOR PIT CONSTRUCTION DETAIL.
- 2. SEE DRAWING NO. 201 FOR PIT MATERIALS SPECIFICATIONS.
- 3. SEE DRAWING NO. 203 FOR PIPING SPECIFICATIONS.
- 4. ANY POST INDICATOR SHALL BE TYPE THAT WILL ATTACH TO WHEEL OPERATOR AND ALLOW OPERATION OF VALVE WITHIN THE PIT.
- 5. ANY PUMPER CONNECTION SHALL BE INSTALLED DOWNSTREAM OF FIRE BRANCH OUTLET VALVE AND ANY BACKFLOW DEVICE.
- 6. SHADED AREA INDICATES WHAT THE PROPERTY OWNER WILL MAINTAIN AFTER THE WARRENTY PERIOD EXPIRES.
- 7. A BACKFLOW PREVENTION ASSEMBLY SHALL BE INSTALLED AS THE FIRST DEVICE INSIDE THE BUILDING ON THE DOMESTIC WATER LINE. THERE SHALL BE NO BRANCHES OR TAPS BETWEEN THE METERING ASSEMBLY AND THE BACKFLOW PREVENTION ASSEMBLY.

REVISION	BY	DATE
N. K.Y. WATER DISTRICT		
DUAL SERVICE BRANCH		
SETTING W/2.5" & LARGER METER		
DRAWN BY: SAR		
APPROVED: RH		
DATE: 2/02/11		
STANDARD DRAWING NO: 207R		