


PLAN

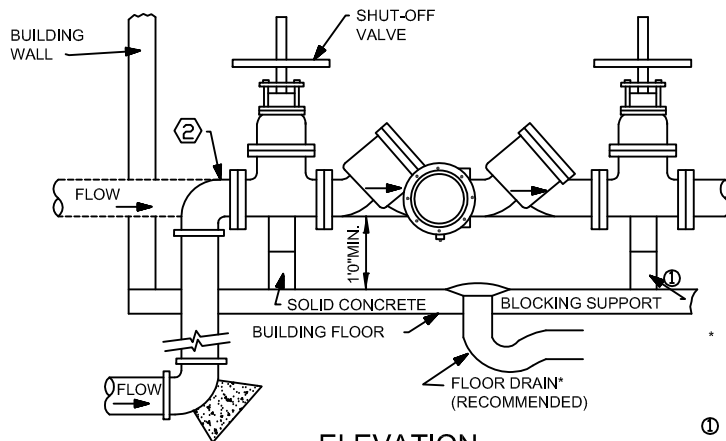

ELEVATION

\* In Lieu of a Floor Drain, The Discharge From The Reduced Pressure Backflow Prevention Device May Be Piped to a Sewer Provided an Approved Air-Gap is Maintained @ The Relief Valve of the Device.

① As Necessary

**DRAWING NOTES**

- ① APPROVED BACKFLOW PREVENTION ASSEMBLY.
- ② PIPING - FLANGED ENDS AND ANCHORED AS NECESSARY.

**GENERAL NOTES**

1. THE DEVICE SHALL BE LOCATED AS CLOSE AS POSSIBLE TO THE POINT WHERE THE PIPING ENTERS THE BUILDING.
2. THE SERVICE PIPING BETWEEN THE METER AND THE BACKFLOW PREVENTION DEVICE SHALL BE VOID OF ANY BRANCHES OR OUTLETS.
3. THE DEVICE SHALL BE LOCATED NO MORE THAN 5 FEET FROM THE FLOOR.
4. A MINIMUM OF 2 FEET SHALL BE MAINTAINED BETWEEN THE TEST COCKS AND ANY WALLS OR ANY OTHER OBJECTS.

REVISION	BY	DATE
N. KY. WATER DISTRICT		
BACKFLOW PREVENTION ASSEMBLY INSTALLED IN A BUILDING		
DRAWN BY: SAR		
APPROVED: <i>RA</i>		
DATE: 2/17/10		
STANDARD DRAWING NO: 302		